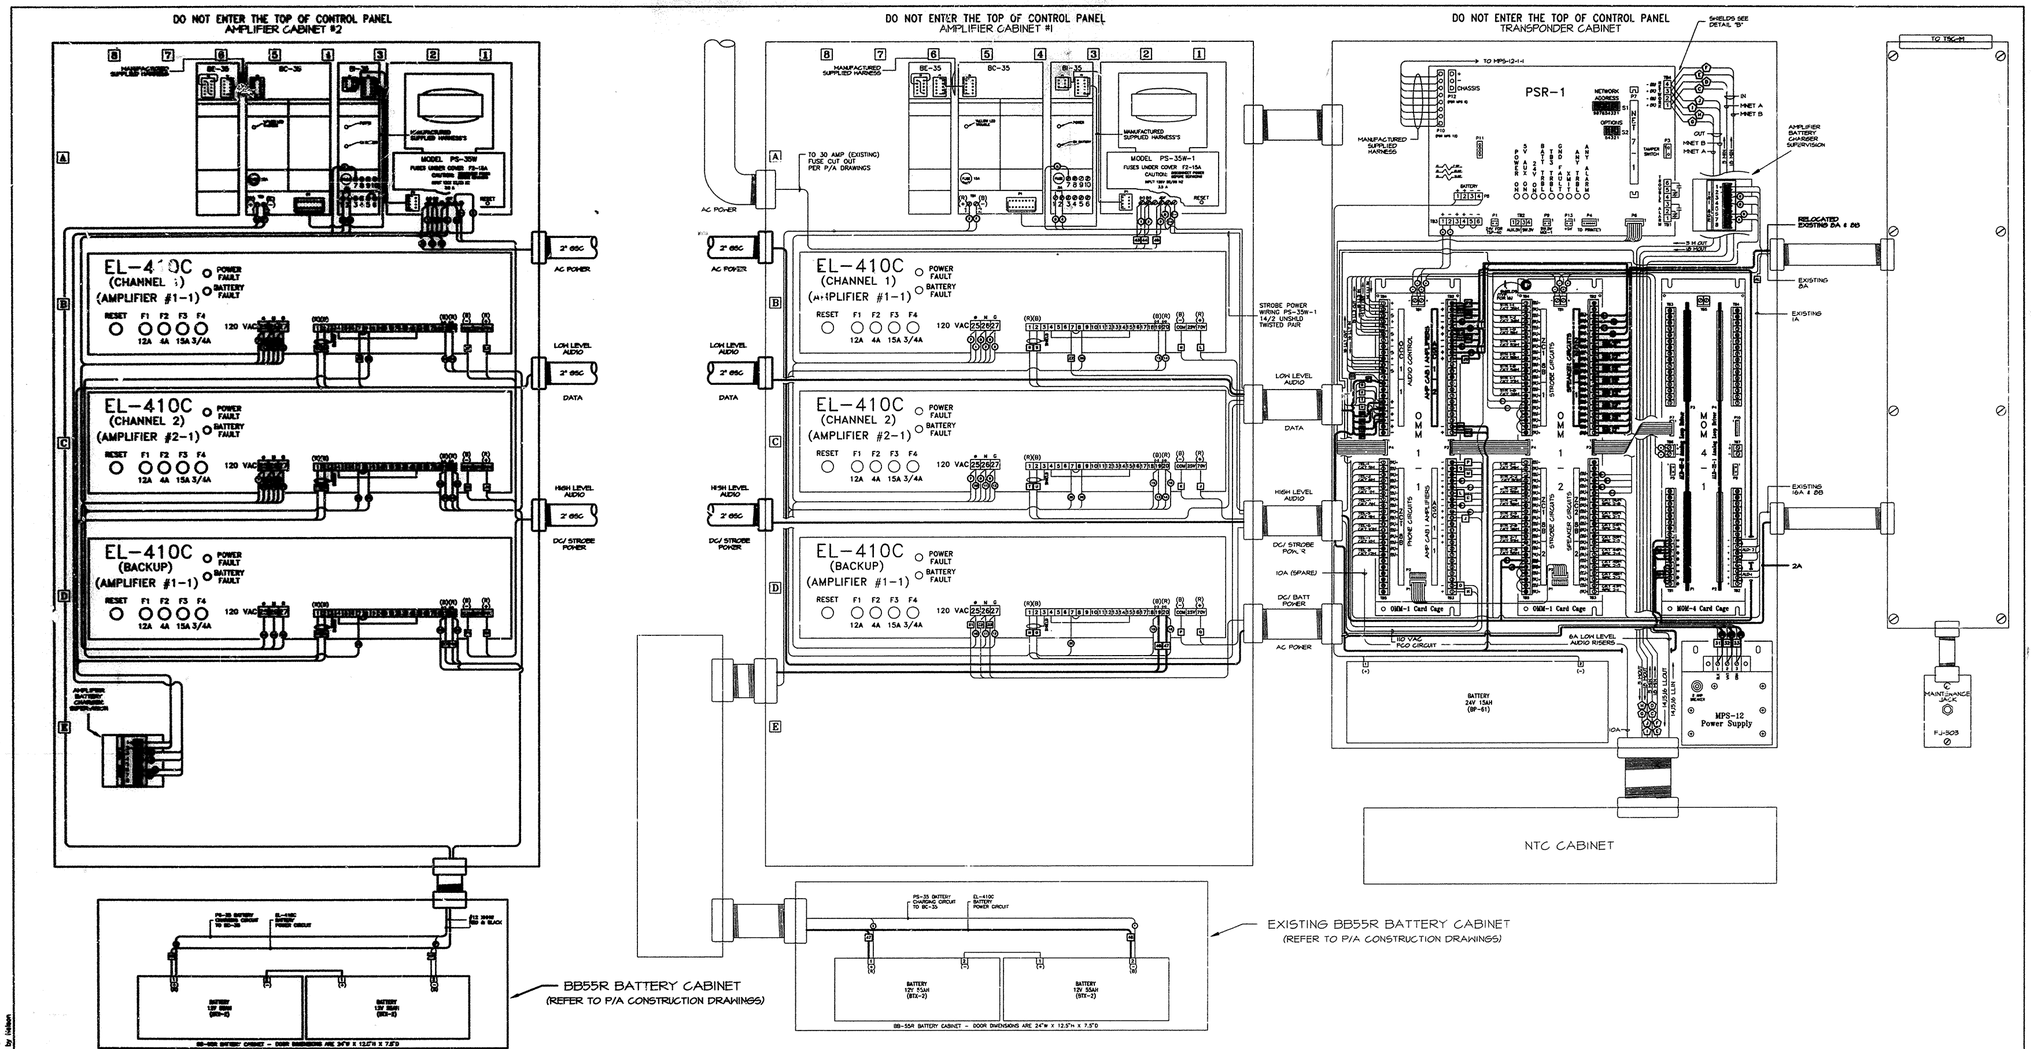

LEGEND		WIRING	NOTES
XNET-A	X-NETWORK "A" CIRCUITS	1. ALL AC POWER WIRING SHALL BE #10 AWG XHHW-2 (WHITE & BLACK)	1.) SYSTEM SHALL BE INSTALLED IN ACCORDANCE WITH SIEMENS-CERBERUS DIVISION SPECIFICATIONS, APPLICABLE CODES & THE CONTRACT DOCUMENTS. DISCREPANCIES, CONFLICTS AND OMISSIONS FOUND ON ANY DOCUMENT, DRAWING, SKETCH, ETC. SHALL BE REPORTED IMMEDIATELY TO THE SIEMENS-CERBERUS DIVISION PROJECT MANAGER. INSTALLING CONTRACTOR SHALL NOT PROCEED UNTIL CLARIFICATION & / OR RESOLUTION IS ISSUED IN WRITING BY SIEMENS-CERBERUS DIVISION PROJECT MANAGER. ALL WORK SHALL BE FULLY INSPECTED AND TESTED BY A CERTIFIED SYSTEMS TECHNICIAN DESIGNATED BY THE SIEMENS-CERBERUS DIVISION PROJECT MANAGER. SYSTEMS SHALL NOT BE POWERED UP PRIOR TO THIS POINT.
XNET-B	X-NETWORK "B" CIRCUITS	2. AMPLIFIER BATTERY WIRING SHALL BE #10 AWG XHHW-2 (RED & BLACK)	
MNET-A	M-NETWORK "A" CIRCUIT	3. HIGH LEVEL AUDIO, SPEAKER, CONTROL & SOLENOID CIRCUITS SHALL BE #14 AWG UNSHIELDED TEFLON.	
MNET-B	M-NETWORK "B" CIRCUIT	4. LOW LEVEL AUDIO, NETWORK, ALD, STROBE, TELEPHONE CIRCUITS SHALL BE #14 AWG SHIELDED TEFLON.	2.) ALL CONNECTIONS MADE DIRECTLY OR INDIRECTLY TO SIEMENS-CERBERUS DIVISION EQUIPMENT AND SYSTEMS SHALL BE IN ACCORDANCE WITH ALL SIEMENS-CERBERUS DIVISION DRAWINGS, SPECIFICATIONS, BULLETINS AND SPECIFICATION EQUIPMENT, METHODS OR MATERIALS NOT LISTED AND APPROVED FOR USE WITH THIS EQUIPMENT BY SIEMENS-CERBERUS DIVISION SHALL NOT BE EMPLOYED.
LL1	LOW LEVEL CHANNEL 1 RISER (PAGE/ALERT)	5. ALL WIRING DEVICES, TERMINALS, CONNECTORS, ETC SHALL BE UL LISTED / MEA APPROVED FOR THE TYPE WIRE USED.	
LL2	LOW LEVEL CHANNEL 2 RISER (EVAC)	6. ALL TERMINAL CONNECTORS FOR #10 AWG SHALL BE APPROVED FOR SOLID WIRE CONNECTION.	3.) CONTRACTOR SHALL PERFORM ALL WORK SHOWN ON SIEMENS-CERBERUS DIVISION DRAWINGS, WHICH INCLUDES INTERNAL WIRING REMOVAL, CHANGES & ADDITIONS AND EXTERNAL WIRING TERMINATIONS AS WELL AS COMPONENT INSTALLATION. ALL WORK SHALL BE PERFORMED IN THE PRESENCE OF THE ENGINEER.
LLT	LOW LEVEL TELEPHONE RISER (TEL)		
HL1	HIGH LEVEL CHANNEL 1		
HL2	HIGH LEVEL CHANNEL 2		
ALD	ANALOG LOOP DRIVER (L-4)		
CSM	CONVENTIONAL SIGNAL MODULE (S-4)		
———	DARK SOLID LINE(S) INDICATE WORK TO BE DONE.		
———	LIGHT SOLID LINE(S) INDICATE EXISTING TO REMAIN.		
———	DARK CENTER LINE(S) INDICATE EXISTING WIRING RELOCATED		

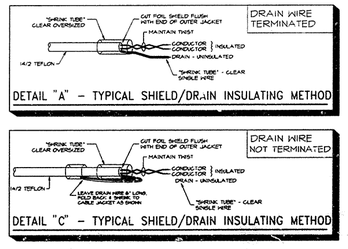



NO.	DATE	DESCRIPTION
1	4/9/99	ISSUE DRAWING AND SEQUENCE OF OPERATION
2		
3		
4		
5		
6		
7		
8		

SIEMENS

Siemens Building Technologies, Inc.
DIRECT SALES DIVISION-SPECIAL PROJECTS / NYC
8 EDGEWOOD ROAD / LOWER ARMK, NJ 07032

Cerberus Division

tel: (800) 631-3841

DRAWINGS PREPARED FOR

FIRE ALARM SYSTEM
TRANSPONDER INSTALLATION
5 WORLD TRADE CENTER
PLAZA LEVEL

DRAWN BY:	N.P.
SCALE:	NONE
DATE:	4/9/99
JOB NO:	86:372
CHECKED BY:	J.D.
SHEET NO:	MK(RV-NE-M2-2

2 OF 2

FILE NAME: D:\DWG\NE-PLAZA\WRK\NE-M2-2.dwg plotted on 5/17/1999 by nelson